Test Report

No.: JER25400918 Date: 13-May-2025

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

SAMPLE NAME : Epoxy Molding Compounds / KE-G1250HT-FC-V(KE-G1250HT-FC)
_KE-G1250HT-FC2-V(KE-G1250HT-FC2)

CLIENT REF.NO :

THE ABOVE SAMPLE(S) AND INFORMATION WERE PROVIDED BY THE APPLICANT.
上記のサンプル並びに情報は顧客により提供されました。

==========

SAMPLE RECEIVED
サンプル受領日 : 16-Apr-2025

TESTING DATE
分析期間 : 16-Apr-2025 to 13-May-2025

TEST REQUESTED
分析項目 : SELECTED TEST(S) AS REQUESTED BY CLIENT.
分析項目は顧客の要求によります。

TEST METHOD(S)
分析方法 : WITH REFERENCE TO LATEST EDITION OF IEC62321 FOR RoHS 10 SUBSTANCES.
OTHER CHEMICALS WERE TESTED BY EACH APPROPRIATE METHOD.
RoHS10物質の分析は最新版のIEC62321を参照しました。
それ以外の化学物質についてはそれぞれに最適な方法で分析を行いました。

TEST RESULT(S)
分析結果 : PLEASE REFER TO THE NEXT PAGE(S).
以下のページをご参照願います。

CHECK REPORT

PIN CODE: 4A0698D9

丸山 文隆

Fumitaka Maruyama / Quality Officer
Central Chemical Laboratory
SGS Japan Inc.

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

Test Result(s)

Test Item(s)/ Location	Method	Unit	MDL	Result
Cadmium(Cd)	IEC62321-5: 2013, ICP-OES	mg/kg	2	N.D.
Lead(Pb)	IEC62321-5: 2013, ICP-OES	mg/kg	2	N.D.
Mercury(Hg)	IEC62321-4: 2013+AMD1: 2017, ICP-OES	mg/kg	2	N.D.
Chromium VI(Cr(VI))	IEC62321-7-2: 2017, UV-VIS	mg/kg	8	N.D.
Polybrominated biphenyl(PBBs)				
Monobromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Dibromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Tribromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Tetrabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Pentabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Hexabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Heptabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Octabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Nonabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Decabromobiphenyl	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Polybrominated diphenyl ether(PBDEs)				
Monobromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Dibromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Tribromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Tetrabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Pentabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Hexabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Heptabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Octabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Nonabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Decabromodiphenyl ether	IEC62321-6: 2015, GC/MS	mg/kg	5	N.D.
Diisobutyl phthalate(DIBP)	IEC62321-8: 2017, GC/MS	mg/kg	50	N.D.
Dibutyl phthalate(DBP)	IEC62321-8: 2017, GC/MS	mg/kg	50	N.D.
Butylbenzyl Phthalate(BBP)	IEC62321-8: 2017, GC/MS	mg/kg	50	N.D.
Di(2-ethylhexyl) phthalate(DEHP)	IEC62321-8: 2017, GC/MS	mg/kg	50	N.D.
Fluorine(F)	BS EN14582(2016)/ Combustion, IC	mg/kg	50	N.D.
Chlorine(Cl)	BS EN14582(2016)/ Combustion, IC	mg/kg	50	N.D.
Bromine(Br)	BS EN14582(2016)/ Combustion, IC	mg/kg	50	N.D.
Iodine(I)	BS EN14582(2016)/ Combustion, IC	mg/kg	50	N.D.

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

Test Item(s)/ Location	Method	Unit	MDL	Result
Perfluorooctanoic acid(PFOA)	EN 17681-1, LC/MS/MS	mg/kg	0.01	N.D.
Perfluorooctane sulfonates(PFOS)	EN 17681-1, LC/MS/MS	mg/kg	0.01	N.D.
Beryllium(Be)	EPA3052, ICP-OES	mg/kg	10	N.D.
Antimony(Sb)	EPA3052, ICP-OES	mg/kg	2	N.D.


NOTE: mg/kg = ppm, MDL = Method Detection Limit, N.D. = Not Detected

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the samples(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

分析フローチャート MEASUREMENT FLOW CHART


酸分解前処理において試料を完全分解しています。
The sample was dissolved/ decomposed totally by acid pre-conditioning method according to below flow chart.

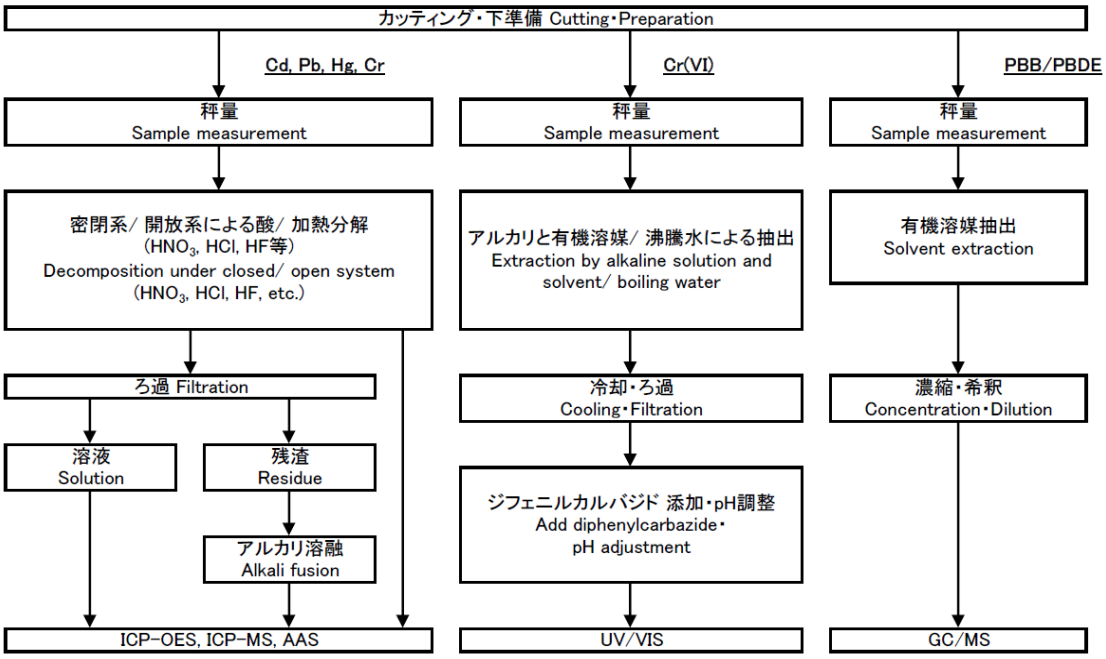

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

分析フローチャート MEASUREMENT FLOW CHART

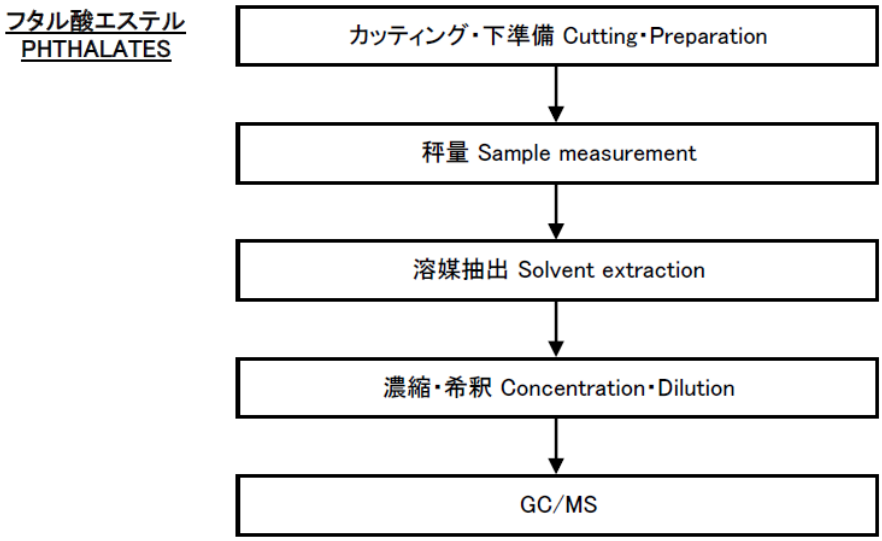


This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

分析フローチャート MEASUREMENT FLOW CHART

ハロゲン HALOGEN

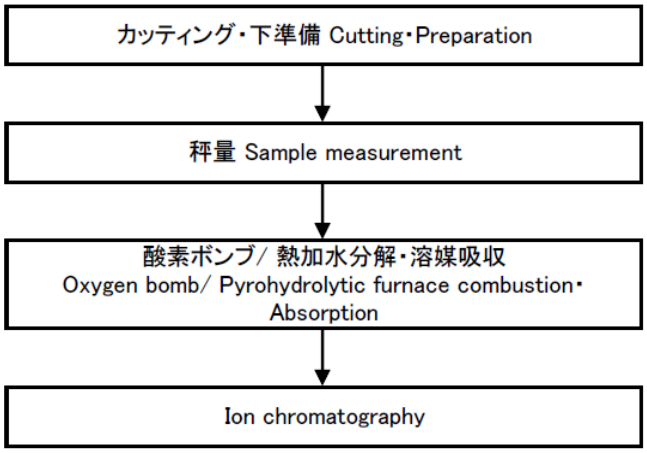


This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

分析フローチャート MEASUREMENT FLOW CHART

ペルフルオロ化合物(PFCs)
PERFLUORINATED
COMPOUNDs(PFCs)

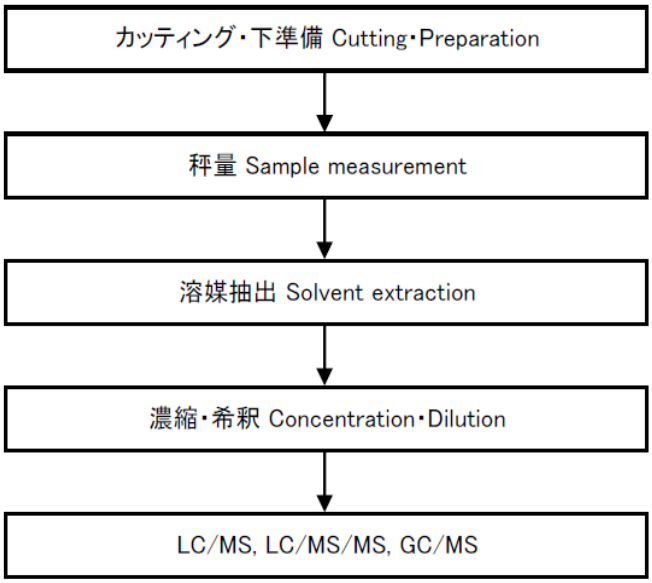


This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

分析フローチャート MEASUREMENT FLOW CHART

酸分解前処理において試料を完全分解しています。
The sample was dissolved/ decomposed totally by acid pre-conditioning method according to below flow chart.

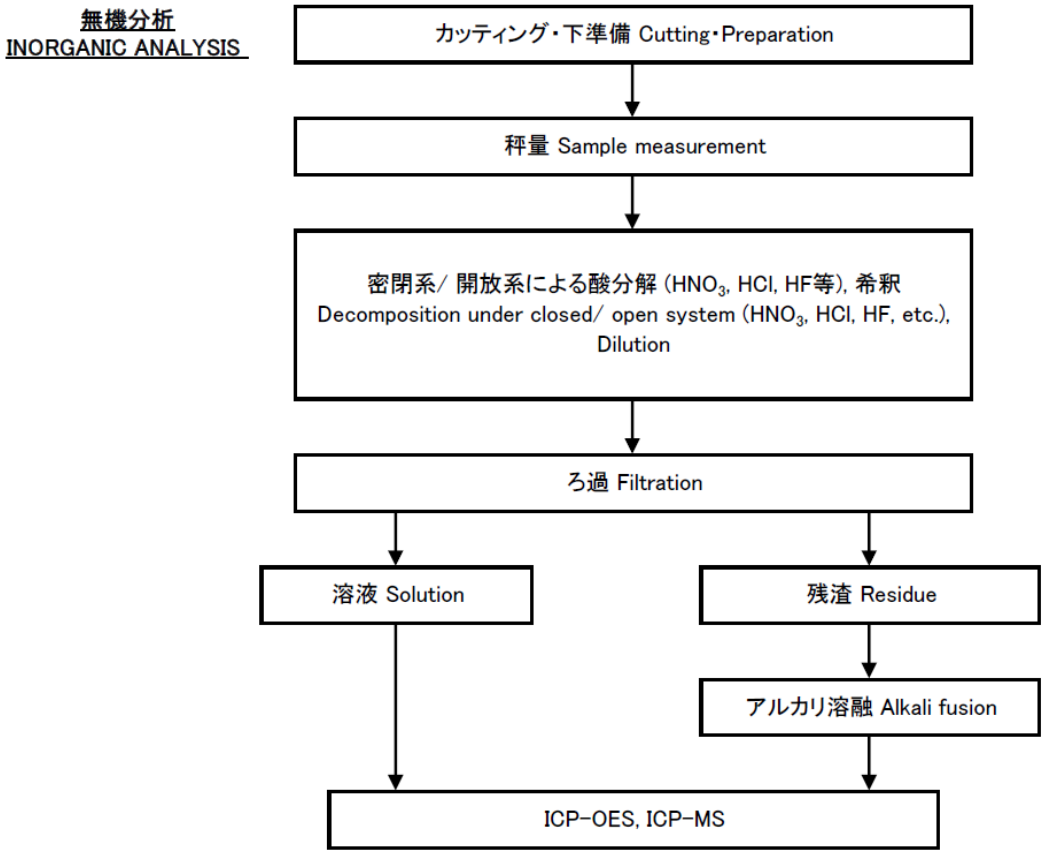

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。

KYOCERA CORPORATION
2-17 MACHIIKEDAI KORIYAMA-SHI FUKUSHIMA JAPAN

Sample Image

JER25400918



** End of Report **

This Test Report is issued by the Company under its General Conditions of Service printed overleaf or available on request and accessible at http://www.sgs.com. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Unless otherwise stated the results shown in this Test Report refer only to the sample(s) tested. This Test Report cannot be reproduced except, in full, without prior approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this test report is unlawful and offenders may be prosecuted to the fullest extent of the law.
この検査報告書は裏面に記載された、もしくはhttp://www.sgs.comで入手が可能なサービスに関する一般的条件に則して発行されます。そちらに明記されている弊社の負うべき債務・補償の範囲及び司法管轄の項目をご注意ください。他に特に明記のない限り、この検査報告書に記載された結果は、検査した試料のみに属します。この書面全体の複製以外には、弊社からの事前の許可を得ること無く複製することを禁じます。この検査報告書を無断で変更、偽造、改ざんすることは違法であり、違反者に対しては法的手段を講じることとなります。